



**PLAN VIEW**

N.T.S.

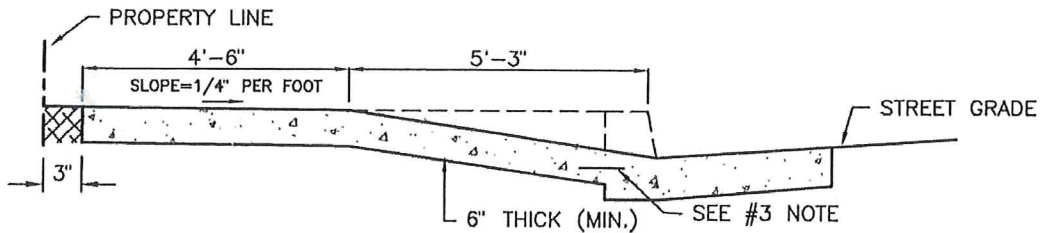

**SECTION A-A**

N.T.S.

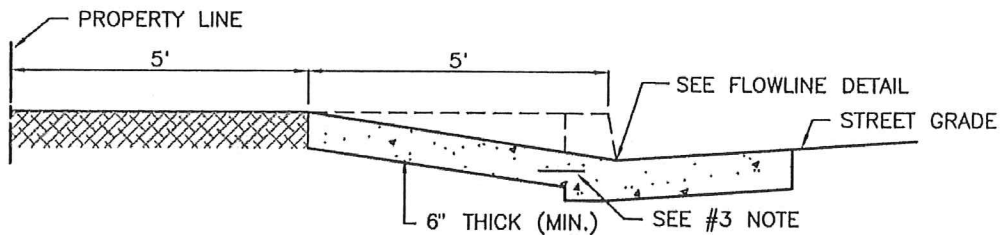

**SECTION B-B**

N.T.S.

**NOTES:**

1. WHERE EXPANSIVE SOILS ARE ENCOUNTERED, AS SET FORTH IN THE STANDARD SPECIFICATIONS, 6" OF IMPORTED SAND, COMPACTED TO 90% RELATIVE COMPACTION, SHALL BE PLACED UNDER THE CURB, GUTTER, AND SIDEWALK.
2. MATERIAL SHALL BE CLASS "A" CONCRETE IN ACCORDANCE WITH SECTION 7 OF THE STD. SPECIFICATIONS.
3. IN LIEU OF A CONTIGUOUS CURB/SIDEWALK SECTION, THE CONTRACTOR MAY USE DOWELS. DOWELS SHALL BE #3 SMOOTH BARS, 12" LONG, SET 4" INTO THE CURB AND 8" INTO THE SIDEWALK AT 48" C-C. AREA ALONG CURB, EXTENDING 2 FEET UNDER THE SIDEWALK, SHALL BE TREATED WITH SOIL STERILANT TO PREVENT WEED GROWTH BETWEEN CURB AND SIDEWALK.

**DRIVE APPROACH  
CONSTRUCTION**

Rev.

Date: 10/1/03

*Harry A. Town*  
City Engineer

**STD.  
NO.  
P-4**