



CURB, GUTTER & SIDEWALK SCRIBE LINE DETAIL
N.T.S.

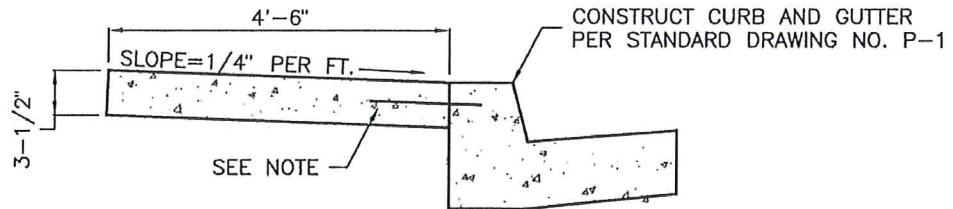

NOTE:

IN LIEU OF A CONTIGUOUS CURB/SIDEWALK SECTION, THE CONTRACTOR MAY USE DOWELS. DOWELS SHALL BE #3 SMOOTH BARS, 12" LONG, SET 4" INTO THE CURB AND 8" INTO THE SIDEWALK AT 48" C-C. AREA ALONG CURB, EXTENDING 2 FEET UNDER THE SIDEWALK, SHALL BE TREATED WITH SOIL STERILANT TO PREVENT WEED GROWTH BETWEEN CURB AND SIDEWALK.

CONTIGUOUS CURB, GUTTER AND SIDEWALK
N.T.S.

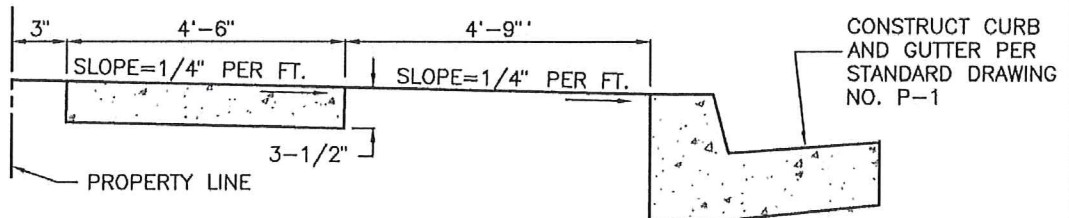

NON-CONTIGUOUS SIDEWALK PATTERN
N.T.S.

NOTES:

1. WHERE EXPANSIVE SOILS ARE ENCOUNTERED, AS SET FORTH IN THE STANDARD SPECIFICATIONS, 6" OF IMPORTED SAND, COMPACTED TO 90% RELATIVE COMPACTION, SHALL BE PLACED UNDER THE CURB, GUTTER AND SIDEWALK.
2. IN THE AREA BETWEEN THE NEW CURB AND GUTTER AND THE EXISTING STREET SURFACE PROVIDE A MINIMUM OF 24" TRANSITION PAVING AT A MINIMUM OF 2" A.C. OVER 6" A.B. OR MATCH EXISTING STREET SECTION.
3. THE AREA BETWEEN CURB AND SIDEWALK SHALL BE FILLED TO 0.10' BELOW TOP OF SURROUNDING CONCRETE WITH CLEAN TOP SOIL FREE OF DEBRIS.
4. SCRIBE LINE DETAIL APPLIES TO BOTH CONTIGUOUS AND NON-CONTIGUOUS PATTERNS.
5. CONCRETE SHALL BE CLASS "B" IN ACCORDANCE WITH SECTION 7 OF THE STANDARD SPECIFICATIONS.

SIDEWALK

Rev.

Date: 10/1/03

Nancy A. Tow
City Engineer

**STD.
NO.
P-3**