

**ADDENDUM NUMBER 1**

**FOR THE**

**CITY OF LEMOORE**

**INDUSTRIAL PARK DEVELOPMENT**  
**PHASE 1 & PHASE 2**

**May 15, 2020**



**OWNER:**  
**City of Lemoore**  
**711 W. Cinnamon Drive**  
**Lemoore, CA 93245**  
**(559) 924-6700**

**PREPARED BY:**  
**A&M**  
**310 W Murray Avenue**  
**Visalia, CA 93291**  
**(559) 429-4747**

## **ADDENDUM NUMBER 1**

---

**The following additions, deletions, or modifications shall become part of the Contract Documents for the City of Lemoore Industrial Park Development Phase 1 & Phase 2 project:**

### **REVISIONS TO SPECIFICATIONS:**

#### **ITEM No. 1 REVISION TO FRONT END DOCUMENTS**

- Documents Released on May 8, 2020 named “NOTICE INVITING BIDS, INSTRUCTIONS TO BIDDERS, GENERAL CONDITIONS, SPECIAL PROVISIONS, AND CONTRACT” shall be replaced with new Documents Released on May 15, 2020, “INDUSTRIAL PARK DEVELOPMENT PHASE 1 & PHASE 2 - BID CONDITIONS, GENERAL CONDITIONS, & SPECIAL PROVISIONS”.
- Technical Specifications have been revised to remove “Bid Item Descriptions”.
- Project Plans remain the same.

### **REVISIONS TO DRAWINGS:**

#### **ITEM No. 1 CHAIN LINK FENCE GREEN PRIVACY LATH (SHEET 47):**

- City Standard shown on the plans (Sheet 47) has been revised to exclude the Green Privacy Lath.


### **CONTRACTOR QUESTIONS:**

**Q1:** Specs pg. 21 - refers to city drawing M-12 with 11 ga mesh, (dated 2003), and detail on sheet 47 includes M-8 (dated 2019) with 9 ga mesh, both with 1 1/2" mesh size. Would a 9ga 3x5" mesh with pre-inserted privacy slats be a suitable alternative?

**A1:** No. The plans have been revised to remove the Privacy Green lath. Chain Link fence shall conform to City Standard M-8.

POSTS TOPS, EXTENSION ARMS, STRETCHER BARS AND OTHER REQUIRED FITTINGS AND HARDWARE SHALL BE COMMERCIAL QUALITY, OR BETTER, AND SHALL BE GALVANIZED STEEL OR MALLEABLE IRON OR WROUGHT IRON.

WIRE USED IN THE MANUFACTURING OF THE FABRIC SHALL BE NO. CASE 9 ASW-GAUGE COPPER STEEL WIRE FOR ALL FENCE 72 INCH OR LESS IN HEIGHT, AND SHALL BE WOVEN INTO APPROXIMATELY 1-1/2 INCH MESH.

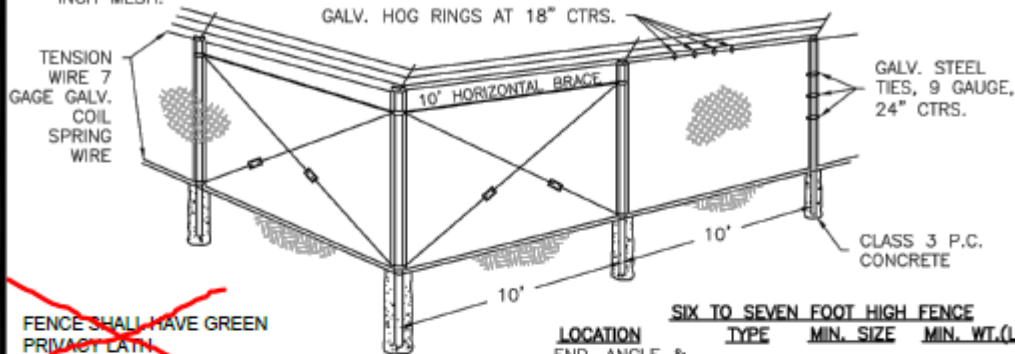

~~FENCE SHALL HAVE GREEN PRIVACY LATH.~~

LINE POSTS SHALL BE SPACED AT NOT MORE THAN 10 FEET INTERVALS, MEASURED FROM CENTER TO CENTER OF POSTS.


END, CORNER, AND GATE POSTS SHALL BE BRACED TO THE NEAREST LINE POST WITH GALVANIZED DIAGONAL OR HORIZONTAL BRACES USED AS COMPRESSION MEMBERS AND GALVANIZED 3/8 INCH STEEL TRUSS RODS WITH TURNBUCKLES USED AS TENSION MEMBERS.

SIX TO SEVEN FOOT HIGH FENCE			
LOCATION	TYPE	MIN. SIZE	MIN. WT.(LB./FT.)
END, ANGLE & CORNER POSTS	PIPE	3.000" O.D.	5.79
LINE POSTS	PIPE	2.300" O.D.	3.10
BRACES	H-SECTION	2.250"	3.90
	PIPE	1.625" O.D.	2.27

FENCES LESS THAN SIX FEET HIGH			
LOCATION	TYPE	MIN. SIZE	MIN. WT.(LB./FT.)
END, ANGLE & CORNER POSTS	PIPE	2.500" O.D.	3.65
LINE POSTS	PIPE	2.000" O.D.	2.72
BRACES	H-SECTION	2.000"	2.80
	PIPE	1.625" O.D.	2.27

#### GATE POSTS

GATE OPENING	MIN. SIZE	MIN. WT.(LB./FT.)
6' TO 12'	3.000" O.D.	5.79
OVER 12'	4.000" O.D.	9.10

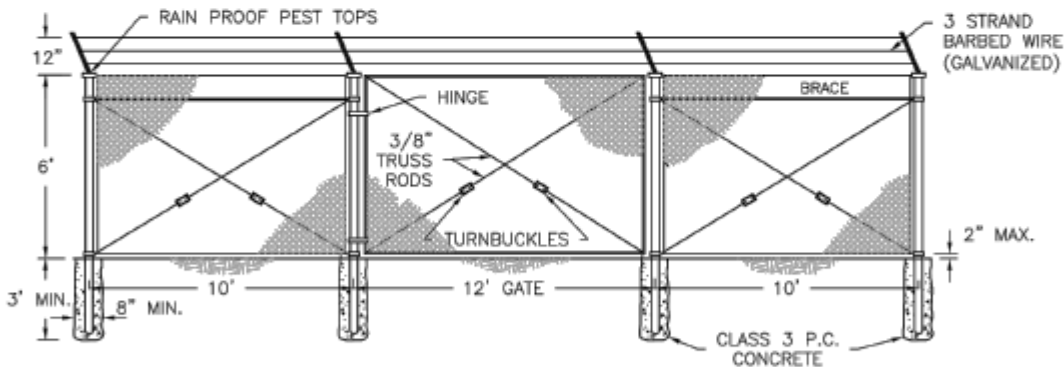

GATE FRAME SHALL BE CONSTRUCTED OF NOT LESS THAN 1.86 INCH DIA. GALVANIZED PIPE AND SHALL BE CROSS TRUSSED WITH 3/8 INCH ADJUSTABLE TRUSS RODS. THE CORNER OF GATE FRAMES SHALL BE FASTENED TOGETHER WITH A MALLEABLE IRON FITTING OR WELDED AND GALVANIZE COATED OVER WELDS.

THE GATE SHALL BE HUNG BY AT LEAST TWO STEEL OR MALLEABLE IRON HINGES NOT LESS THAN 3 INCHES IN WIDTH, AND A MALLEABLE CATCH AND LOCKING ATTACHMENT.

ALL POSTS SHALL BE A MINIMUM OF 9 FEET LONG.

FILE: M-8.DWG

## CHAIN LINK FENCING AND GATE

Date: 12/17/19

STD.  
NO.  
M-8

Rev.

City Engineer

**NOTE: One copy of this Addendum Number 1 shall be signed by the Contractor and must be submitted with the bid as acknowledgement of receipt and the acceptance of this Addendum Number 2.**

Prepared by:   
Orfil Muniz, P.E.  
A&M Consulting Engineers

May 15, 2020  
Date

Accepted by: \_\_\_\_\_  
Contractor (signature)

\_\_\_\_\_  
Date