


CURB, GUTTER AND SIDEWALK SCRIBE LINE DETAIL

N.T.S.

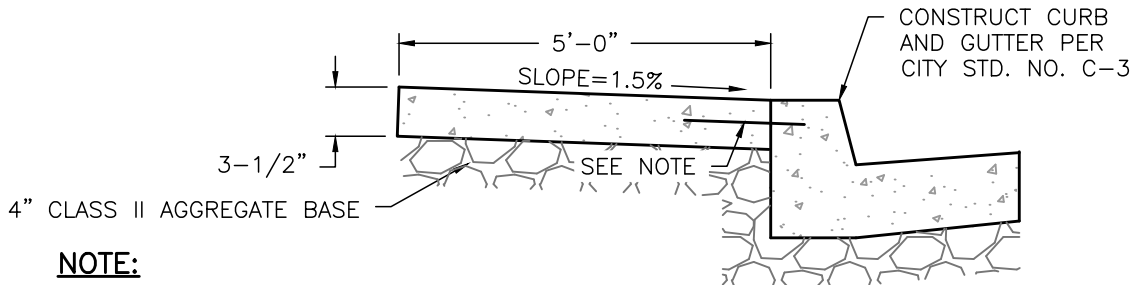


NOTE:

IN LIEU OF A CONTIGUOUS CURB/SIDEWALK SECTION, THE CONTRACTOR MAY USE DOWELS. DOWELS SHALL BE #3 SMOOTH BARS, 12 INCH LONG, SET 4 INCH INTO THE CURB AND 8 INCH INTO THE SIDEWALK AT 48 INCH C-C. AREA ALONG CURB, EXTENDING 2 FEET UNDER THE SIDEWALK, SHALL BE TREATED WITH SOIL STERILANT TO PREVENT WEED GROWTH BETWEEN CURB AND SIDEWALK.

CONTIGUOUS CURB, GUTTER, AND SIDEWALK

N.T.S.

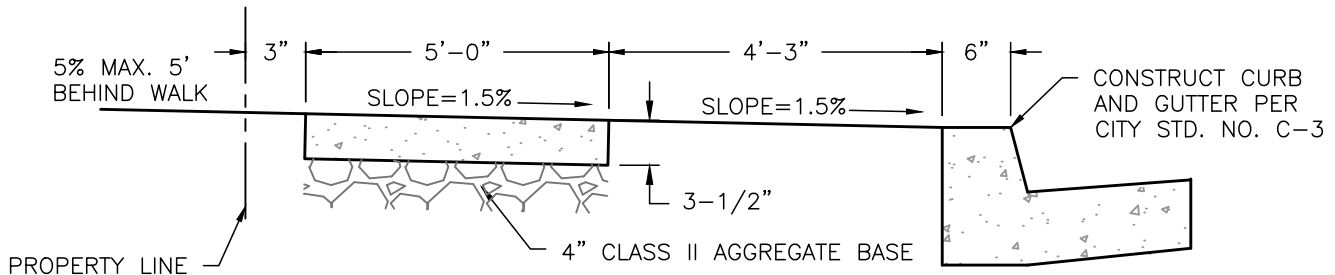

NON-CONTIGUOUS SIDEWALK PATTERN

N.T.S.

NOTES:

1. WHERE EXPANSIVE SOILS ARE ENCOUNTERED, AS SET FORTH IN THE STANDARD SPECIFICATIONS, 6 INCH OF IMPORTED SAND, COMPACTED TO 90% RELATIVE COMPACTION, SHALL BE PLACED UNDER THE CURB, GUTTER AND SIDEWALK.
2. IN THE AREA BETWEEN THE NEW CURB AND GUTTER AND THE EXISTING STREET SURFACE PROVIDE A MINIMUM OF 24 INCH TRANSITION PAVING AT A MINIMUM OF 2 INCH A.C. OVER 6 INCH A.B. OR MATCH EXISTING STREET SECTION.
3. THE AREA BETWEEN CURB AND SIDEWALK SHALL BE FILLED TO 0.10 FOOT BELOW TOP OF SURROUNDING CONCRETE WITH CLEAN TOP SOIL FREE OF DEBRIS.
4. SCRIBE LINE DETAIL APPLIES TO BOTH CONTIGUOUS AND NON-CONTIGUOUS PATTERNS.
5. CONCRETE SHALL BE CLASS 2 IN ACCORDANCE WITH SECTION 16 OF THE CITY STANDARD SPECIFICATIONS

FILE: C-5.DWG


SIDEWALK LOCAL STREETS

Date: 12/17/19

[Signature]
City Engineer


**STD.
NO.
C-5**

Rev.

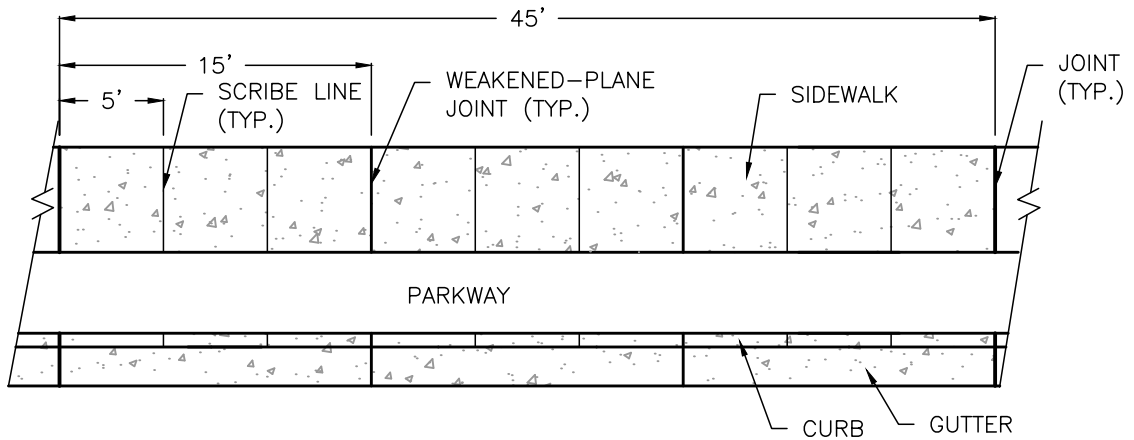

CURB, GUTTER, AND SIDEWALK SCRIBE LINE DETAIL

N.T.S.

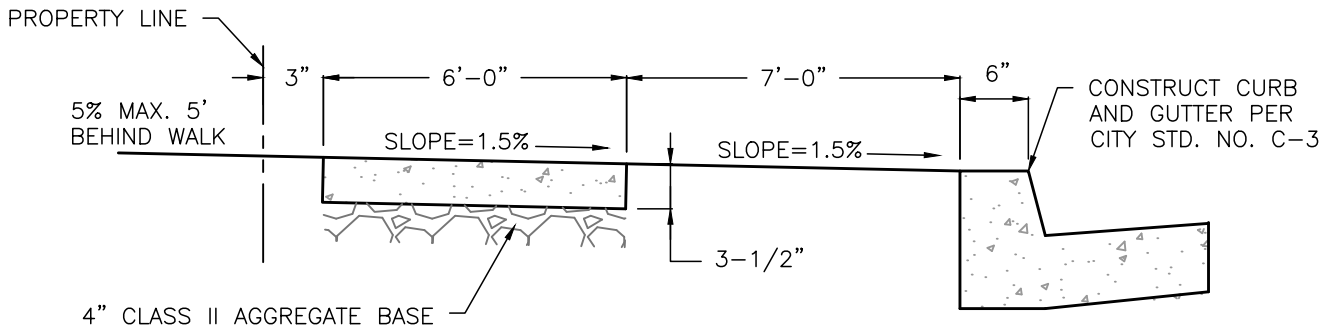

NON-CONTIGUOUS SIDEWALK PATTERN

N.T.S.

NOTES:

1. WHERE EXPANSIVE SOILS ARE ENCOUNTERED, AS SET FORTH IN THE CITY STANDARD SPECIFICATIONS, 6 INCH OF IMPORTED SAND, COMPACTED TO 90% RELATIVE COMPACTION, SHALL BE PLACED UNDER THE CURB, GUTTER AND SIDEWALK.
2. IN THE AREA BETWEEN THE NEW CURB AND GUTTER AND THE EXISTING STREET SURFACE PROVIDE A MINIMUM OF 24 INCH TRANSITION PAVING AT A MINIMUM OF 2 INCH A.C. OVER 6 INCH A.B. OR MATCH EXISTING STREET SECTION.
3. THE AREA BETWEEN CURB AND SIDEWALK SHALL BE FILLED TO 0.10 FOOT BELOW TOP OF SURROUNDING CONCRETE WITH CLEAN TOP SOIL FREE OF DEBRIS.
4. SCRIBE LINE DETAIL APPLIES TO BOTH CONTIGUOUS AND NON-CONTIGUOUS PATTERNS.
5. CONCRETE SHALL BE CLASS 2 IN ACCORDANCE WITH SECTION 16 OF THE CITY STANDARD SPECIFICATIONS.

FILE: C-5A.DWG


**SIDEWALK AT COLLECTORS
AND ARTERIALS**

Date: 12/17/19


[Signature]
City Engineer

**STD.
NO.
C-5A**


Rev.

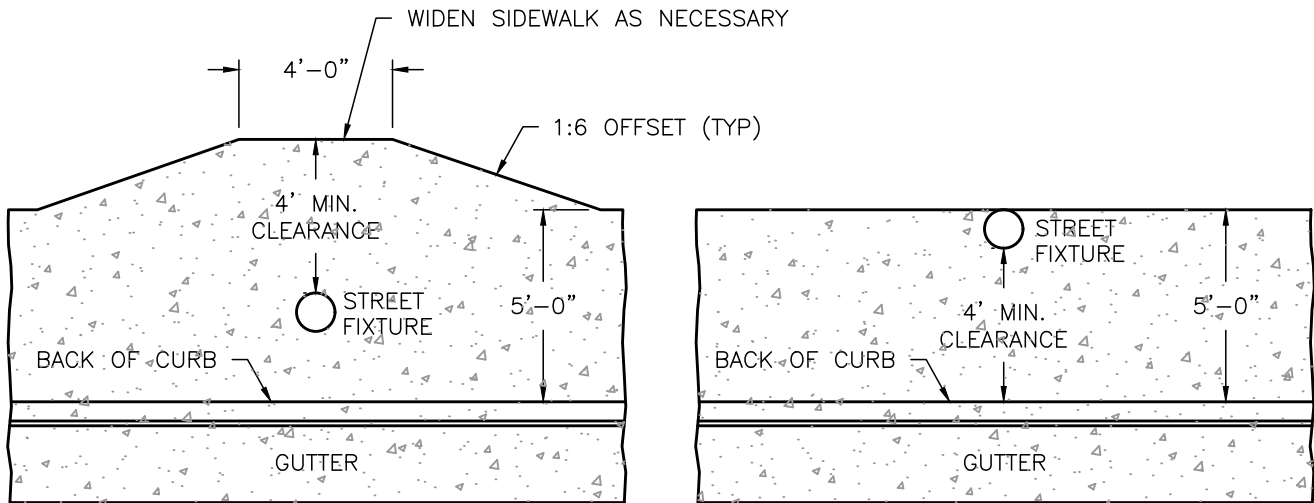

PLAN WITH STREET FIXTURE
N.T.S.

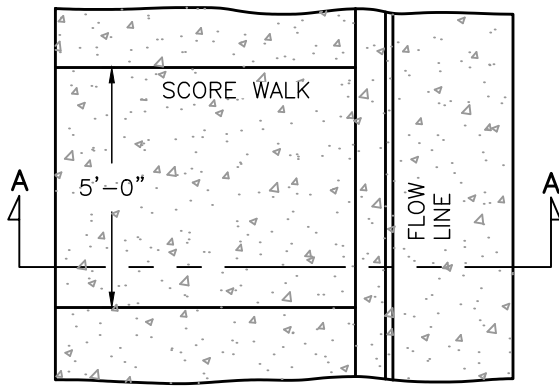

PLAN
N.T.S.

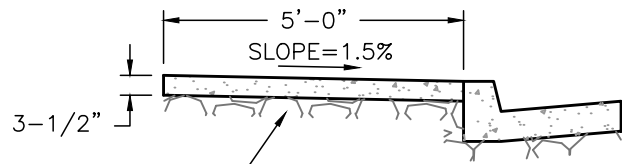

4" CLASS II AGGREGATE BASE

SECTION A-A
N.T.S.

NOTES:

1. ALL CONCRETE SHALL BE CLASS 2 IN ACCORDANCE WITH SECTION 16 OF THE CITY STANDARD SPECIFICATIONS.
2. SIDEWALK SHALL BE WIDENED AT STREET FIXTURE LOCATIONS PROVIDING A MINIMUM CLEARANCE OF 4 FEET TO BACK OF SIDEWALK.
3. WHERE EXPANSIVE SOILS ARE ENCOUNTERED, AS SET FORTH IN THE STANDARD SPECIFICATIONS, 6 INCH OF IMPORTED SAND, COMPACTED TO 90% RELATIVE COMPACTION, SHALL BE PLACED UNDER THE CURB, GUTTER AND SIDEWALK.

FILE: C-5B.DWG

**SIDEWALK - RESIDENTIAL
ADJACENT TO CURB**

Date: 12/17/19

[Signature]
City Engineer

**STD.
NO.
C-5B**

Rev.